

## **NOTES:**

- 1. THIS DRAWING IS FOR ILLUSTRATIVE PURPOSES ONLY!
- 2. ALL TESTING SHALL BE PERFORMED BY QUALIFIED PERSONNEL, WITH PROPER PERSONAL PROTECTIVE EQUIPMENT
- 3. THE PRODUCTION METER AND AC DISCONNECT SHOULD BE LOCATED TOGETHER IN A READILY ACCESSIBLE LOCATION WITHIN 10' OF THE MAIN SERVICE METER
- 4. 24/7 UNESCORTED KEYLESS ACCESS
  SHALL BE PROVIDED FOR THE METERS
  AND AC DISCONNECT
- 5. UTILITY AC DISCONNECT SHOULD BE LOCATED WITHIN 10 FEET OF THE MAIN SERVICE METER
- 6. NOTE ALL THE APPLICABLE NEC CODES
- 7. SHOW ALL THE SYSTEMS INCLUDING STORAGE, EXISTING AND NEW (IF APPLICABLE)

### **PV SYSTEM:**

ROOF SLOPE: 20°
AZIMUTH: 180°
PV MODULES: 320W
TOTAL: 14

MODULES PER STRING: 14


## **RACK CONFIGURATION:**

#### **INVERTER INFORMATION:**

3.8 KW UL CERTIFIED INTVERTER, (1) DC/AC RATIO: 1.179


## **ABBREVIATIONS:**

- 1. FOH: FRONT OF HOUSE
- 2. FSB: FIRE SET BACKS
- 3. (E): EXISTING
- 4. (N): NEW
- 5. PV: PHOTOVOLTAIC
- 6. MAX: MAXIMUM
- 7. OCPD: OVERCURRENT PROTECTION DEVICE
- 8. PCC: POINT OF COMMON COUPLING
- 9. PoC: POINT OF DER CONNECTION
- 10. RPA: REFERENCE POINT OF APPLICABILITY

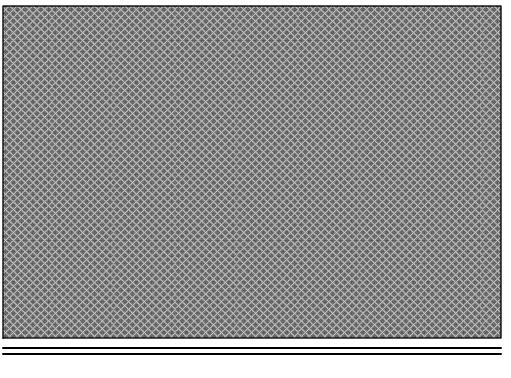

CUSTOMER NAME

#### **JOHN DOE**

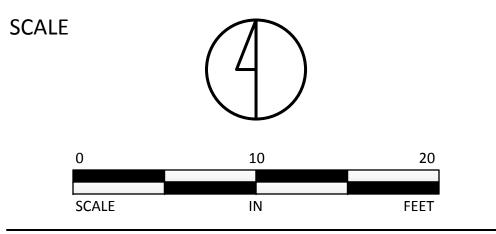

**PROJECT** 

# EXAMPLE DRAWINGS FOR SMALL SOLAR INTERCONNECTIONS

**INSTALLATION ADDRESS** 

**INSTALLER NAME AND CONTACT** 

SHEET

#### **SITE PLAN**

SUBMITTAL

## **EXAMPLE**

_#	DATE	REVISION
1	12/1/2018	INITIAL SUBMITTAL
2	12/15/2018	UTILITY COMMENTS
3	6/17/2019	CORRECTED SUBMITTAL

APPLICATION OID, SRC, OR CASE NUMBER

PROFESSIONAL CERTIFICATION

**DRAWN BY**JANE DOE

**CHECKED BY** 

UTE I. LITTY

DATE

PROJECT NUMBER

6/17/2019 2019-100.01

SHEET NUMBER
E-101-01A

SYSTEM SIZE: 3.8kW AC/4.48kW DC




## **NOTES:**

- 1. THIS DRAWING IS FOR ILLUSTRATIVE PURPOSES ONLY!
- 2. ALL TESTING SHALL BE PERFORMED BY QUALIFIED PERSONNEL, WITH PROPER PERSONAL PROTECTIVE **EQUIPMENT**
- 3. INSTALLATION SHALL COMPLY WITH NEC 690 AND ALL APPLICABLE LOCAL, STATE, AND NATIONAL CODES AND **STANDARDS**
- 4. EQUIPMENT LABELS SHALL BE IN ACCORDANCE WITH NEC 690 AND XCEL ENERGY STANDARDS
- 5. 24/7 UNESCORTED KEYLESS ACCESS SHALL BE PROVIDED FOR THE METERS AND AC DISCONNECT
- 6. EQUIPMENT PAD SHALL CONTAIN INVERTER, GROUNDING TRANSFORMER, AND STEP-UP TRANSFORMER PER PROJECT SINGLE LINE DIAGRAM
- 7. SHOW ALL THE SYSTEMS INCLUDING STORAGE, EXISTING AND NEW (IF APPLICABLE)
- 8. PROVIDE FUSED, VISIBLE, LOCKABLE DISCONNECT MOUNTED ON DISCONNECT POLE. CLEARLY LABEL DISCONNECT PER XCEL ENERGY GUIDELINES.


## **ABBREVIATIONS:**

- 1. FOH: FRONT OF HOUSE
- 2. FSB: FIRE SET BACKS
- 3. (E): EXISTING
- 4. (N): NEW
- 5. PV: PHOTOVOLTAIC
- 6. MAX: MAXIMUM
- 7. OCPD: OVERCURRENT PROTECTION DEVICE
- 8. PCC: POINT OF COMMON COUPLING
- 9. PoC: POINT OF DER CONNECTION
- 10. RPA: REFERENCE POINT OF APPLICABILITY

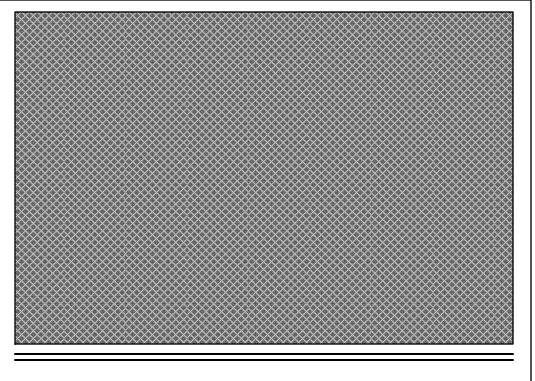

**CUSTOMER NAME** 

#### **JOHN DOE**

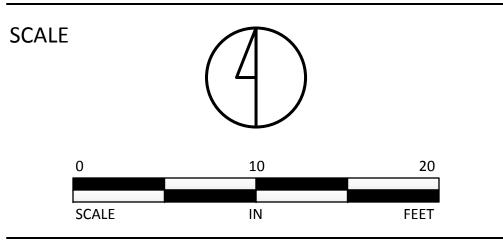

#### **PROJECT**

## **EXAMPLE DRAWINGS FOR DEDICATED** POWER PRODUCTION FACILITY INTERCONNECTION (STAND ALONE DER)

**INSTALLATION ADDRESS:** 

7726 COUNTY ROAD 19, COTTAGE GROVE, MN

GPS: 44.836166, -92.903365

INSTALLER NAME AND CONTACT

SHEET

#### **SITE PLAN**

**SUBMITTAL** 

## **EXAMPLE**

#	DATE	REVISION
1	12/1/2018	INITIAL SUBMITTAL
2	12/15/2018	UTILITY COMMENTS
3	6/17/2019	CORRECTED SUBMITTAL

APPLICATION OID, SRC, OR CASE NUMBER

PROFESSIONAL CERTIFICATION

**DRAWN BY** JANE DOE

DATE

**CHECKED BY** 

UTE I. LITTY

**PROJECT NUMBER** 

6/17/2019 2019-100.01

SHEET NUMBER

E-101-01B

7726-7750 County Road 19 PROJECT VICINITY

Google

**SERVICE METER** UTILITY DISCONNECT | CUSTOMER DISCONNECT **Location: Distance:** 

**SYSTEM SIZE:** 1000kW AC

AREA EPS METER

AND DISCONNECT

CUSTOMER

DISCONNECT

UNDERGROUND MEDIUM VOLTAGE

AC CIRCUIT FROM EQUIPMENT PAD


TO CUSTOMER DISCONNECT SWITCH

EQUIPMENT PAD,

SEE NOTES

#### **ONE LINE EXAMPLE A:**

FOR SINGLE INVERTER SYSTEMS

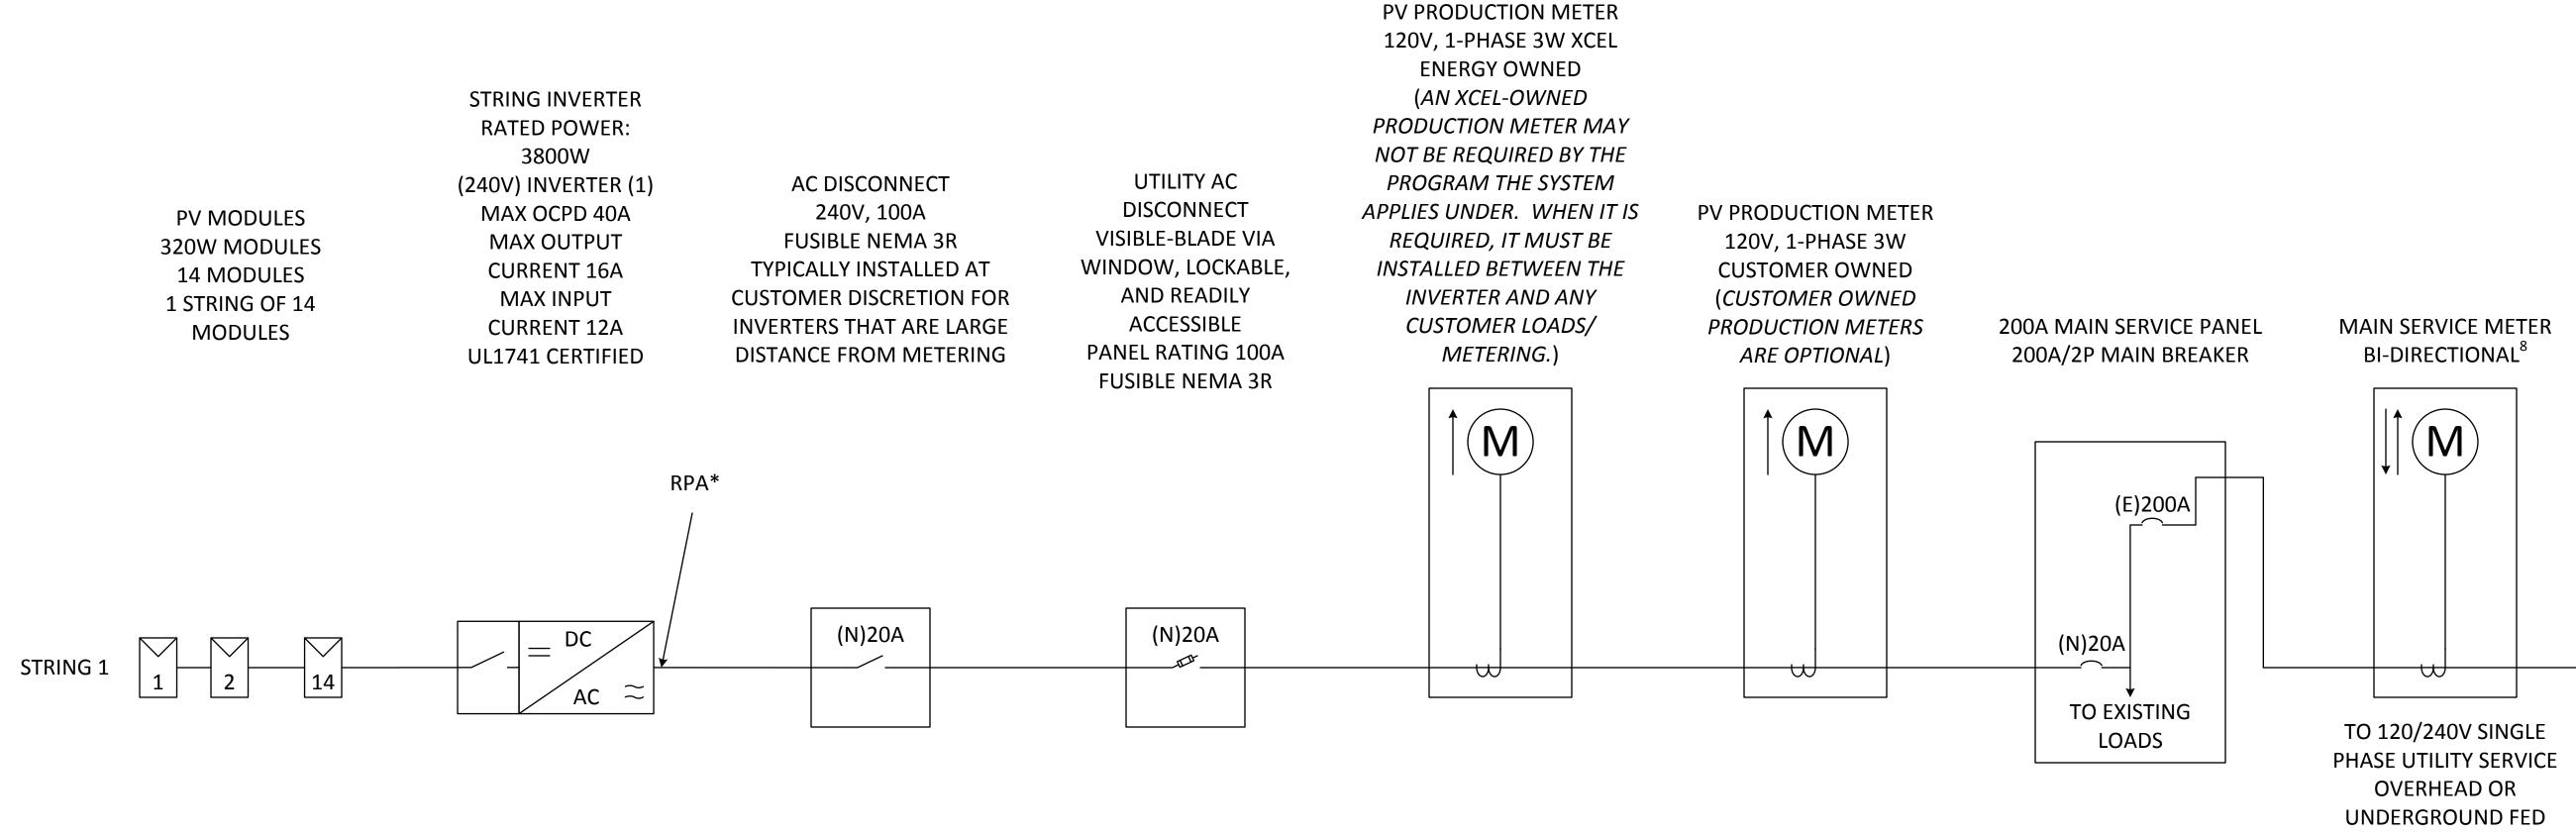

	PV MODULE	INVERTER	UTILITY DISCONNECT	PV METER	MAIN SERVICE PANEL	INTERCONNECTION METHOD
Make:						
Model:						
Rating:						
Total:						

## **NOTES:**

- 1. THIS DRAWING IS FOR ILLUSTRATIVE **PURPOSES ONLY!**
- 2. ALL TESTING SHALL BE PERFORMED BY QUALIFIED PERSONNEL, WITH PROPER PERSONAL PROTECTIVE EQUIPMENT
- 3. THE PRODUCTION METER AND AC DISCONNECT SHOULD BE LOCATED TOGETHER IN A READILY ACCESSIBLE LOCATION WITHIN 10' OF THE MAIN SERVICE METER
- 4. 24/7 UNESCORTED KEYLESS ACCESS SHALL BE PROVIDED FOR THE METERS AND AC DISCONNECT
- 5. UTILITY AC DISCONNECT SHOULD BE LOCATED WITHIN 10 FEET OF THE MAIN SERVICE METER
- 6. NOTE ALL THE APPLICABLE NEC CODES
- 7. SHOW ALL THE SYSTEMS INCLUDING STORAGE, EXISTING AND NEW (IF APPLICABLE)
- 8. SERVICES <320A WILL USE SELF-CONTAINED MAIN SERVICE METERS. 320A SERVICES MUST INDICATE WHETEHER THE METERING WILL BE SELF-CONTAINED OR TRANSFORMER METERED. ALL SERVICES 400A OR GREATER MUST BE TRANSFORMER METERED

#### **PV SYSTEM: RACK CONFIGURATION:**


ROOF SLOPE: 20° AZIMUTH: 180° PV MODULES: 320W TOTAL: 14 MODULES PER STRING: 14

## **INVERTER INFORMATION:**

3.8KW UL CERTIFIED INTVERTER, (1) DC/AC RATIO: 1.179

## **ABBREVIATIONS:**

- 1. FOH: FRONT OF HOUSE
- 2. FSB: FIRE SET BACKS
- 3. (E): EXISTING
- 4. (N): NEW
- 5. PV: PHOTOVOLTAIC
- 6. MAX: MAXIMUM
- 7. OCPD: OVERCURRENT PROTECTION DEVICE
- 8. PCC: POINT OF COMMON COUPLING
- 9. PoC: POINT OF DER CONNECTION
- 10. RPA: REFERENCE POINT OF APPLICABILITY

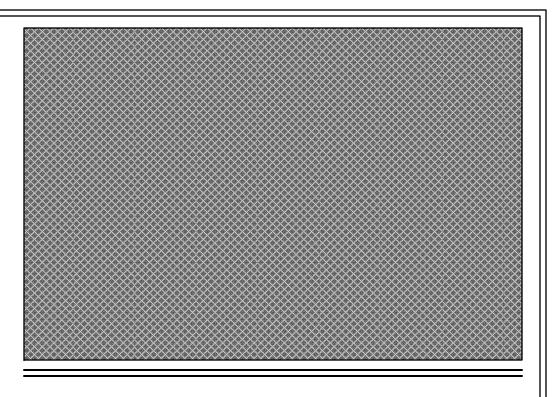

**CUSTOMER NAME** 

**JOHN DOE** 

SCALE

**PROJECT** 

**EXAMPLE DRAWINGS FOR SMALL SOLAR INTERCONNECTIONS** 

**INSTALLATION ADDRESS** 

**INSTALLER NAME AND CONTACT** 

SHEET

**ONE LINE DIAGRAM** 

**SUBMITTAL** 

**EXAMPLE** 

#	DATE	REVISION
1	12/1/2018	INITIAL SUBMITTAL
2	12/15/2018	UTILITY COMMENTS
3	6/17/2019	CORRECTED SUBMITTAL

APPLICATION OID, SRC, OR CASE NUMBER

PROFESSIONAL CERTIFICATION

**DRAWN BY** 

**CHECKED BY** 

JANE DOE

UTE I. LITTY

DATE 6/17/2019


**PROJECT NUMBER** 2019-100.01

3.8kW AC/4.48kW DC

\*AS DETERMINED **BY IEEE 1547** 

**SYSTEM SIZE:** 

SHEET NUMBER E-101-02A

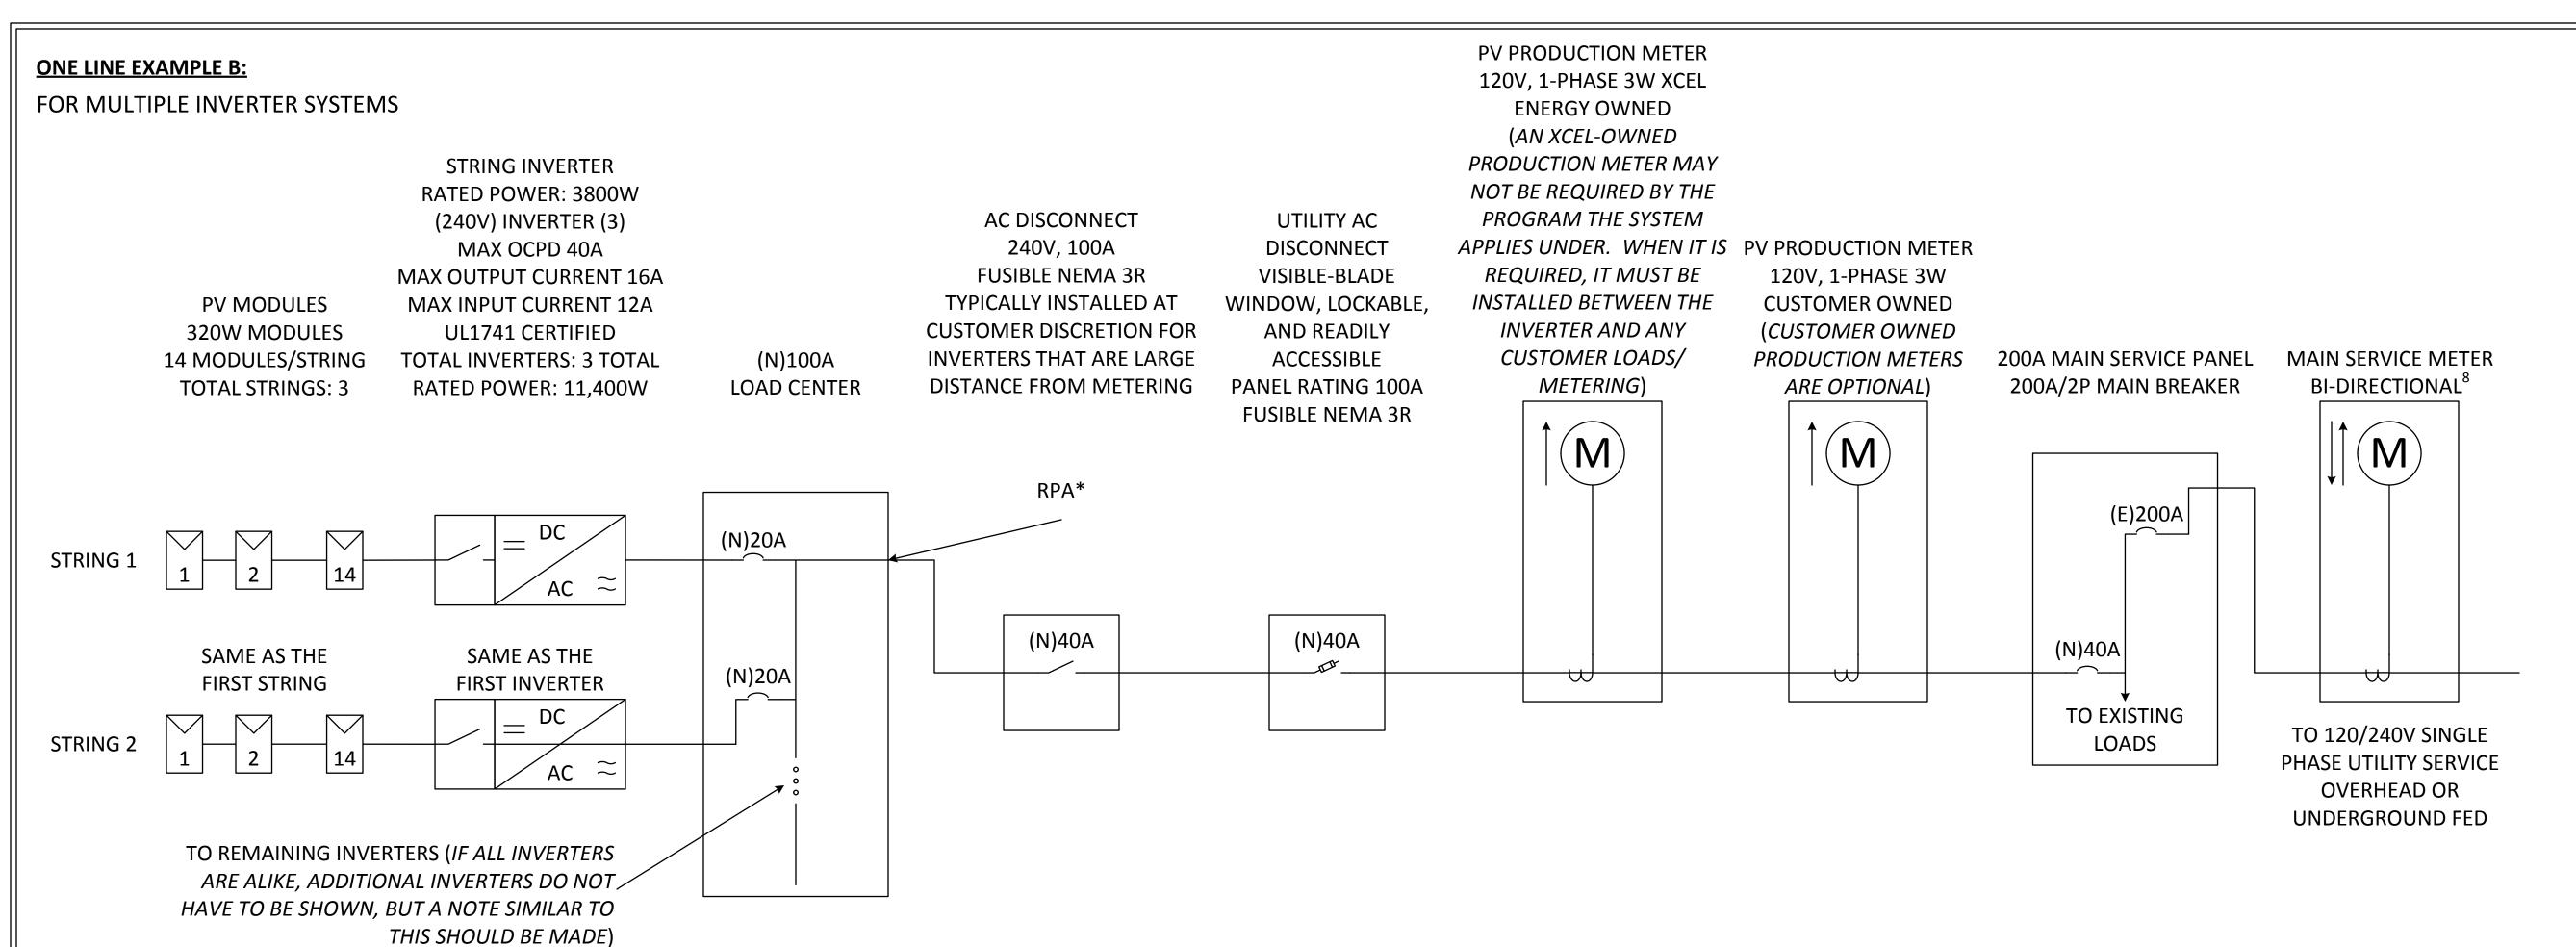

	PV MODULE	INVERTER	UTILITY DISCONNECT	PV METER	MAIN SERVICE PANEL	INTERCONNECTION METHOD
Make:						
Model:						
Rating:						
Total:						

## **NOTES:**

- 1. THIS DRAWING IS FOR ILLUSTRATIVE **PURPOSES ONLY!**
- 2. ALL TESTING SHALL BE PERFORMED BY QUALIFIED PERSONNEL, WITH PROPER PERSONAL PROTECTIVE EQUIPMENT
- 3. THE PRODUCTION METER AND AC DISCONNECT SHOULD BE LOCATED TOGETHER IN A READILY ACCESSIBLE LOCATION WITHIN 10' OF THE MAIN SERVICE METER
- 4. 24/7 UNESCORTED KEYLESS ACCESS SHALL BE PROVIDED FOR THE METERS AND AC DISCONNECT
- 5. UTILITY AC DISCONNECT SHOULD BE LOCATED WITHIN 10 FEET OF THE MAIN SERVICE METER
- 6. NOTE ALL THE APPLICABLE NEC CODES
- 7. SHOW ALL THE SYSTEMS INCLUDING STORAGE, EXISTING AND NEW (IF APPLICABLE)
- 8. SERVICES <320A WILL USE SELF-CONTAINED MAIN SERVICE METERS. 320A SERVICES MUST INDICATE WHETEHER THE METERING WILL BE SELF-CONTAINED OR TRANSFORMER METERED. ALL SERVICES 400A OR GREATER MUST BE TRANSFORMER METERED

## **PV SYSTEM:**

ROOF SLOPE: 20° AZIMUTH: 180° PV MODULES: 320W TOTAL: 32 MODULES PER STRING: 14

#### **RACK CONFIGURATION:**


**INVERTER INFORMATION:** 

## 3.8KW UL CERTIFIED INTVERTER, (3) DC/AC RATIO: 1.179

1. FOH: FRONT OF HOUSE

**ABBREVIATIONS:** 

- 2. FSB: FIRE SET BACKS
- 3. (E): EXISTING
- 4. (N): NEW
- 5. PV: PHOTOVOLTAIC
- 6. MAX: MAXIMUM
- 7. OCPD: OVERCURRENT PROTECTION DEVICE
- 8. PCC: POINT OF COMMON COUPLING
- 9. PoC: POINT OF DER CONNECTION
- 10. RPA: REFERENCE POINT OF APPLICABILITY

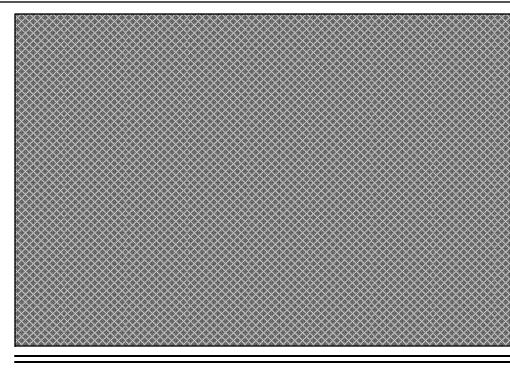

**CUSTOMER NAME** 

JOHN DOE

**SCALE** 

**PROJECT** 

**EXAMPLE DRAWINGS FOR SMALL SOLAR INTERCONNECTIONS** 

**INSTALLATION ADDRESS** 

**INSTALLER NAME AND CONTACT** 

SHEET

**ONE LINE DIAGRAM** 

**SUBMITTAL** 

**EXAMPLE** 

_#	DATE	REVISION
1	12/1/2018	INITIAL SUBMITTAL
2	12/15/2018	UTILITY COMMENTS
3	6/17/2019	CORRECTED SUBMITTAL

APPLICATION OID, SRC, OR CASE NUMBER

PROFESSIONAL CERTIFICATION

**DRAWN BY** 

**CHECKED BY** 

JANE DOE

UTE I. LITTY

DATE

**PROJECT NUMBER** 

6/17/2019 2019-100.01

**SYSTEM SIZE:** 11.4kW AC/13.44kW DC

\*AS **DETERMINED BY IEEE 1547** 

SHEET NUMBER E-101-02B

#### **ONE LINE EXAMPLE C:**

FOR SINGLE OR MULTIPLE INVERTER SYSTEMS – DEDICATED POWER PRODUCTION FACILITY

(STAND ALONE DER)

**PV MODULES:** 

**MODULE RATING** 

MODULES/STRING

TOTAL STRINGS

## **INVERTER:**

RATED POWER RATED VOLTAGE

MAX OCPD MAX OUTPUT CURRENT MAX INPUT CURRENT

UL1741 CERTIFIED TOTAL INVERTERS TOTAL RATED POWER

AZIMUTH: 180°

TOTAL: 32

PV MODULES: 320W

MODULES PER STRING: 14

## **GROUND REFERENCING COMBINER PANEL, AC kW RATING**

**VOLTAGE** 

UL1741 CERTIFIED


**EQUIPMENT: INVERTER, LOAD CENTER:** VARIOUS CONFIGURATIONS AVAILABLE, SHALL MEET XCEL ENERGY **REQUIREMENTS** 

**TRANSFORMER:** TRANSFORMER RATINGS **SERVICE PANEL:** (TRANSFORMER LOCATION PANEL RATING FOR PRIMARY SERVICE SHOWN) BREAKER RATINGS

**PROTECTION EQUIPMENT:** PROTECTION RATINGS PROTECTION DETAILS

**METER:** REQUIEREMENTS

**TRANSFORMER:** TRANSFORMER RATINGS (TRANSFORMER LOCATION SHALL MEET XCEL ENERGY FOR SECONDARY SERVICE SHOWN)

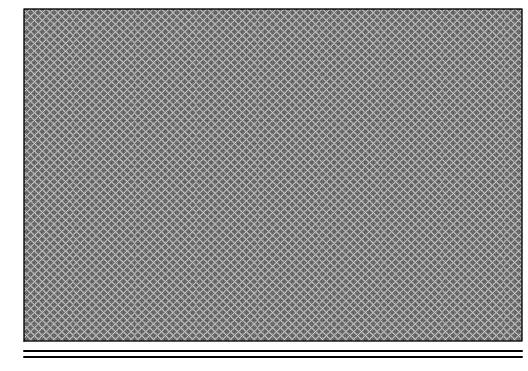

**CUSTOMER NAME JOHN DOE** 

**SCALE** 

**PROJECT** 

**EXAMPLE DRAWINGS FOR DEDICATED** POWER PRODUCTION FACILITY **INTERCONNECTION (STAND ALONE DER)** 

**INSTALLATION ADDRESS** 

**INSTALLER NAME AND CONTACT** 

SHEET

**ONE LINE DIAGRAM** 

**SUBMITTAL** 

**EXAMPLE** 

#	DATE	REVISION
1	12/1/2018	INITIAL SUBMITTAL
_2	12/15/2018	UTILITY COMMENTS
3	6/17/2019	CORRECTED SUBMITTAL

APPLICATION OID, SRC, OR CASE NUMBER

PROFESSIONAL CERTIFICATION

**DRAWN BY** 

**CHECKED BY** 

JANE DOE


UTE I. LITTY

DATE 6/17/2019

2019-100.01

**PROJECT NUMBER** 

SHEET NUMBER E-101-02C

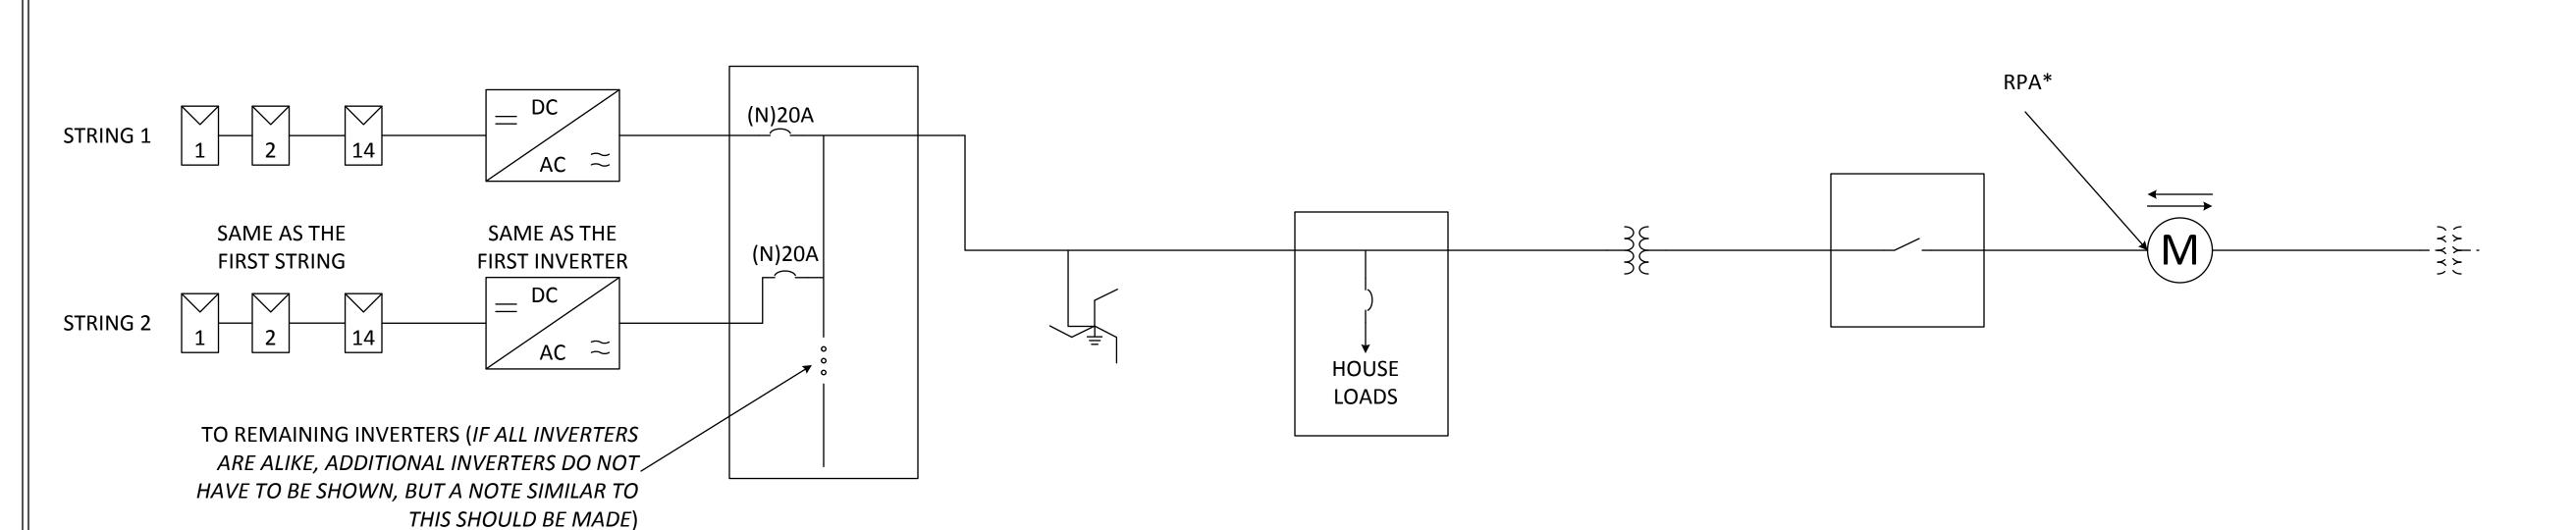

	PV MODULE	INVERTER	UTILITY DISCONNECT	PV METER	MAIN SERVICE PANEL	INTERCONNECTION METHOD
Make:						
Model:						
Rating:						
Total:						

## **NOTES:**

- 1. THIS DRAWING IS FOR ILLUSTRATIVE **PURPOSES ONLY!**
- 2. ALL TESTING SHALL BE PERFORMED BY QUALIFIED PERSONNEL, WITH PROPER PERSONAL PROTECTIVE EQUIPMENT
- 3. THE PRODUCTION METER AND AC DISCONNECT SHOULD BE LOCATED TOGETHER IN A READILY ACCESSIBLE LOCATION WITHIN 10' OF THE MAIN SERVICE METER
- 4. 24/7 UNESCORTED KEYLESS ACCESS SHALL BE PROVIDED FOR THE METERS AND AC DISCONNECT
- 5. UTILITY AC DISCONNECT SHOULD BE LOCATED WITHIN 10 FEET OF THE MAIN SERVICE METER
- 6. NOTE ALL THE APPLICABLE NEC CODES
- 7. SHOW ALL THE SYSTEMS INCLUDING STORAGE, EXISTING AND NEW (IF APPLICABLE)
- 8. SERVICES <320A WILL USE SELF-CONTAINED MAIN SERVICE METERS. 320A SERVICES MUST INDICATE WHETEHER THE METERING WILL BE SELF-CONTAINED OR TRANSFORMER METERED. ALL SERVICES 400A OR GREATER MUST BE TRANSFORMER METERED

#### **PV SYSTEM: RACK CONFIGURATION:** ROOF SLOPE: 20°

**INVERTER INFORMATION:** 

3.8KW UL CERTIFIED INTVERTER, (3) DC/AC RATIO: 1.179

2. FSB: FIRE SET BACKS 3. (E): EXISTING

6. MAX: MAXIMUM

5. PV: PHOTOVOLTAIC

4. (N): NEW

7. OCPD: OVERCURRENT PROTECTION DEVICE

8. PCC: POINT OF COMMON COUPLING

9. PoC: POINT OF DER CONNECTION

**ABBREVIATIONS:** 

1. FOH: FRONT OF HOUSE

10. RPA: REFERENCE POINT OF APPLICABILITY

\*AS **DETERMINED BY IEEE 1547** 

> **SYSTEM SIZE:** 1000 kW AC/1344.00kW DC

## PRODUCTION METER

Photovoltaic Power Source

# <u>WARNING</u>

**ELECTRIC SHOCK HAZARD** 

ENERGIZED

3 THE DC CONDUCTORS OF THIS PHOTOVOLTAIC SYSTEM ARE UNGROUNDED AND MAY BE

**WARNING** 

**ELECTRIC SHOCK HAZARD** 

4

5

DO NOT TOUCH THESE TERMINALS, TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION



**ELECTRIC SHOCK HAZARD** 

WHEN A GROUND FAULT IS ACTIVE **CONDUCTORS THAT ARE** NORMALLY GROUNDED MAY BE UNGROUNDED AND ENERGIZED

**CAUTION** PHOTOVOLTAIC SYSTEM IS BACKFED

## **WARNING** 7

Turn off AC disconnect prior to working inside panel

DO NOT DISCONNECT 8 **UNDER LOAD** 

**PV SYSTEM** 9 DC DISCONNECT

**UTILITY PV SYSTEM** 10 **AC DISCONNECT** 

UTILITY **ENERGY STORAGE SYSTEM AC DISCONNECT** 

**CAUTION** PHOTOVOLTAIC ENERGY IS 12 BEING FED INTO THIS SYSTEM

**CAUTION** DUAL POWER SOURCE **SECOND SOURCE IS A PV** SYSTEM

## **CAUTION**


MAXIMUM OPERATING CURRENT 16A MAXIMUM OPERATING AC VOLTS 240V

## **CAUTION**

NOMINAL OPERATING AC VOLTAGE NOMINAL OPERATING AC FREQUENCY 60Hz MAXIMUM AC POWER 3.8kW **MAXIMUM AC CURRENT** 16A OVERCURRENT PROTECTION RATING 20A

## **NOTES:**

- 1. ALL PLAQUES AND SIGNAGE REQUIRED BY 2014 NEC 690 WILL BE INSTALLED AS REQUIRED
- 2. LABELS, WARNING(S), AND MARKING(S) SHALL COMPLY WITH ANSI Z535.4
- 3. A PERMANENT PLAQUE OR DIRECTORY SHALL BE INSTALLED PROVIDING THE LOCATION OF THE SERVICE DISCONNECTING MEANS IF NOT IN THE SAME LOCATION IN COMPLIANCE WITH NEC 690.56(B)
- 4. WHEN ENERGY STORAGE SYSTEMS (ESS) ARE PRESENT, LABELLING INDICATING THIS SHOULD BE INCLUDED. IF ADDITIONAL DISCONNECTS ARE REQUIRED, THESE SHOULD ALSO BE LABELLES FOR THE ESS AS WELL.

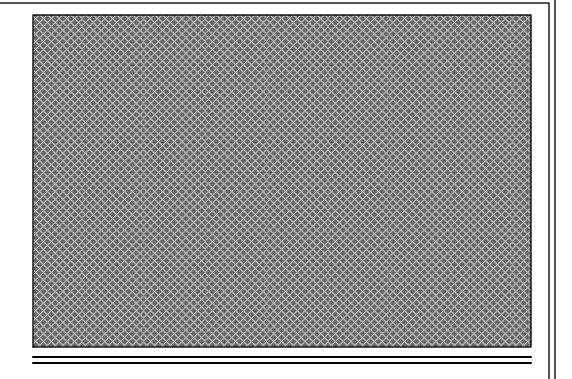

**CUSTOMER NAME** 

**JOHN DOE** 

**SCALE** 

**PROJECT** 

**EXAMPLE DRAWINGS FOR SMALL SOLAR INTERCONNECTIONS** 

**INSTALLATION ADDRESS** 

**INSTALLER NAME AND CONTACT** 

SHEET

#### **LABELS**

**SUBMITTAL** 

## **EXAMPLE**

	Label Locations/Details
1	Production Meter
2	PV System Utility AC Disconnect, Main Service Disconnect
3	DC BUS, DC Disconnect, Inverter(s)
4	PV System Utility AC Disconnect, Main Service Disconnect
5	DC BUS, DC Disconnect, Inverter(s)
6	PV System Utility AC Disconnect, PV-AC Disconnect load side and line side
7	PV-AC Disconnect
8	PV System Utility AC Disconnect
9	PV System DC Disconnect
10	PV System Utility AC Disconnect
11	Main Service Panel (House/Area Panel), Production meter
12	Main Service Panel (House/Area Panel), Production meter
13	PV-AC Disconnect, AC Panel combiner, Production meter
14	PV-AC Disconnect, AC Panel combiner, Production meter

APPLICATION OID, SRC, OR CASE NUMBER

PROFESSIONAL CERTIFICATION

12/1/2018

12/15/2018

6/17/2019

**DRAWN BY** JANE DOE

**CHECKED BY** UTE I. LITTY

**REVISION** 

**INITIAL SUBMITTAL** 

UTILITY COMMENTS

CORRECTED SUBMITTAL

DATE 6/17/2019

**PROJECT NUMBER** 2019-100.01

> SHEET NUMBER E-101-03

**SYSTEM SIZE:** 3.8kW AC/4.48kW DC